



CERTIFICATE OF APPROVAL
No CF 386

This is to certify that, in accordance with
TS00 General Requirements for Certification of Fire Protection Products
The undermentioned products of

SCHOTT UK LIMITED

Drummond Road, Stafford. ST16 3EL
Tel: 01785 223166 Fax: 01785 223522

Have been assessed against the requirements of the Technical Schedule(s)
denoted below and are approved for use subject to the conditions
appended hereto:

CERTIFIED PRODUCT

'PYRANOVA® S2.0/2.1'
Fire Resisting Glass

TECHNICAL SCHEDULE

TS 25 Fire Resistant Glass,
Glazing Systems and Materials

Signed and sealed for and on behalf of CERTIFIRE

Sir Ken Knight
Chairman - Management Council
Page 1 of 29

Issued: 12th April 2005
Revised: 12th November 2010
Valid to: 20th June 2015



Only valid when authentic
Seal is in place
CERTIFIRE



CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® S2.0/2.1 Fire Resisting Glass

This Certificate of Approval relates to the fire resistance of SCHOTT UK Limited 'PYRANOVA® S2.0/2.1' laminated glass products when used in the following applications, as defined in BS EN 1364-1: 1999 subject to the undermentioned conditions.

Glass Specification	Application	Fire Resistance Performance (mins)		Page No.
		Integrity	Insulation	
PYRANOVA® 15-S2.0/2.1	Timber based door leaves	30	Up to 30	5-6
PYRANOVA® 15-S2.0/2.1	Timber framed fixed lights	30	Up to 30	7
PYRANOVA® 15-S2.0/2.1	Steel framed screens	30	30	8
PYRANOVA® 30-S2.0/2.1	Timber based door leaves	30	30	9
PYRANOVA® 30-S2.0/2.1	Timber framed screens	30	30	10
PYRANOVA® 30 S2.0/2.1	Steel based door leaves	30	30	11-12
PYRANOVA® 30 S2.0/2.1	Steel framed screens	30	30	13
PYRANOVA® 30-S2.0/2.1	IGU's in Timber framed screens	30	30	14
PYRANOVA® 30 S2.0/2.1	IGU's in steel based door leaves	30	30	15-16
PYRANOVA® 30 S2.0/2.1	IGU's in metallic framed screens	30	30	17-18
PYRANOVA® 30-S2.0/2.1	IGU's in Timber framed screens	60	30	19
PYRANOVA® 30 S2.0/2.1	IGU's in metallic framed screens	60	30	20
PYRANOVA® 30 S2.0/2.1	Butt-Jointed in timber screens	30	30	21-22
PYRANOVA® 30 S2.0/2.1	Butt-Jointed in steel screens	30	30	23-24
PYRANOVA® 60 S2.0/2.1	Steel door leaves	60	60	25
PYRANOVA® 60 S2.0/2.1	Timber framed screens	60	60	26
PYRANOVA® 60 S2.0/2.1	Steel framed screens	60	60	27
PYRANOVA® 60 S2.0/2.1	IGU's in timber framed screens	60	60	28
PYRANOVA® 60 S2.0/2.1	IGU's in steel framed screens	60	60	29

This product is approved on the basis of:

- a) Initial type testing
- b) A design appraisal against TS25
- c) Certification of quality management system to BS EN ISO 9001: 2008
- d) Inspection and surveillance of factory production control
- e) Audit Testing in accordance with TS25

This Certificate of Approval must be read in conjunction with CERTIFIRE Technical Schedule TS25, Fire Resistant Glass, Glazing Systems and Materials.

General Requirements

Where the glass is installed in a timber or steel framed screen, the orientation of the screen shall be no more than ±10° from the vertical.

There is no restriction to the direction of exposure for the glass. Orientation may, however, be restricted by the requirements of a non-symmetrical framing system or certain insulating glass unit specifications. The edge cover to each pane shall be no less than 12 mm minimum in all systems that utilise frames.



CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® S2.0/2.1 Fire Resisting Glass

The glass is approved in the following nominal thicknesses:

Glass Specification	Application	Fire Resistance Performance (mins)	
		Integrity	Insulation
PYRANOVA® 15-S2.0	11 mm thick (internal)	30	Up to 30
PYRANOVA® 15-S2.1	15 mm thick (external)	30	Up to 30
PYRANOVA® 30-S2.0	15 mm thick (internal)	30*	30
PYRANOVA® 30-S2.1	19 mm thick (external)	30*	30
PYRANOVA® 60-S2.0	23 mm thick (internal)	60	60
PYRANOVA® 60-S2.1	27 mm thick (external)	60	60

* May be used for 60 minutes integrity as part of an insulating glass unit

Maximum Cut Size of PYRANOVA®

The range of PYRANOVA® glasses is currently available up to a maximum size of 2900 mm by 1900 mm.

Silk Screening and Sand-Blasting

The PYRANOVA® glass may be provided with silk screen printing with any colour from the 'RAL' range to either face within both single and insulating glass unit systems. The printing may account for any area of the glass.

Similarly, sand-blasting may be included to either face of the glass. The sand-blasting may account for any area of the glass.

Additionally, sheets of plain, patterned, textured or coloured glass may be laminated to the base product. A silk sheet material may be included within the extra laminate/interlayer.

Alternatively, patterned, textured or coloured glass may be substituted for one of the 3 mm annealed float elements in the base product.

Butt Jointed Systems

The PYRANOVA® glass panes used in butt jointed systems may be substituted with thicker panes without compromising either the fire resistance performance, the maximum permitted glass dimensions or the butt joint specifications.



CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA[®] S2.0/2.1 Fire Resisting Glass

Laminated PYRANOVA[®]

Additional glass from 6 to 19 mm thickness may be laminated to any thickness of PYRANOVA[®] glass using an interlayer from 0.38mm to 1.52 mm thickness.

PYRANOVA[®], when laminated as described above, may be used in any timber or steel framed assemblies covered by this certificate but subject to a maximum pane size of 4.8 m².

Other Glass Combinations


PYRANOVA[®] glass products detailed in this Certificate are also suitable for use either in combination with or laminated to SmartGlass and/or X Ray glass and may be used as one or more panes of a fire tested Insulating Glass Unit construction.

A handwritten signature in black ink, appearing to be "K. J. ...", is written over a faint circular stamp.

CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® 15-S2.0/2.1 Glass in timber door leaves for periods of 30 minutes integrity and 30 or 15 minutes insulation

The glass shall be glazed within a previously fire tested or CERTIFIRE approved timber based doorset utilising the following basic specification:

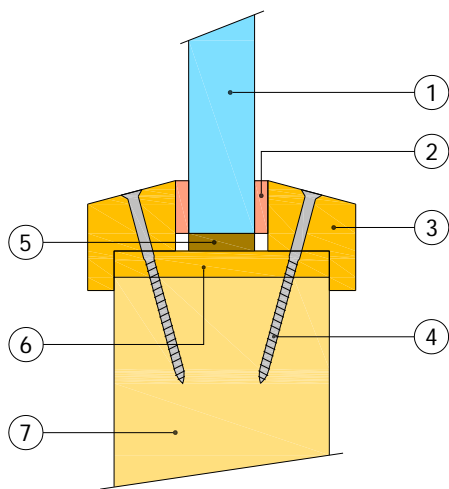

- 1 PYRANOVA® 15-S2.0/2.1 glass
- 2 12 mm by 3 mm Hodgson Sealants Firestrip 30
- 3 Hardwood glazing beads 25 mm high by 20 mm wide (minimum) including 9 mm high by 6 mm wide bolection, either square or up to 15° chamfer, minimum density 640 kg/m³
- 4 45 mm long steel screws at 150 mm centres (30 - 45° to glass)
- 5 Non-combustible setting blocks
- 6 Minimum 6 mm thick hardwood aperture liner (not required on door leaves with a softwood / hardwood timber core of density > 550 kg/m³)
- 7 FD30 door leaf

- The doorset, including door frame and associated building hardware, should have achieved at least 30 minutes integrity (and up to 30 minutes insulation) when tested, or subsequently assessed by one of the laboratories approved by CERTIFIRE as acceptable for this purpose, to BS 476: Part 22: 1987 or BS EN 1634-1: 2000.
- The proposed doorset should also have included a glazed aperture or apertures of the intended size, shape, area and number.
- When used to glaze CERTIFIRE approved doorsets which have smaller apertures than allowed in this certificate, the aperture sizes specified in the doorset certificate shall take precedence.
- The door leaves shall consist of timber faces coupled with timber or other cellulosic cores of minimum overall leaf thickness, 44 mm.
- When an alternative CERTIFIRE approved glazing system is used, the system shall have been shown to be capable of including PYRANOVA® glass. The maximum permitted aperture dimensions shall be as detailed below or included within the relevant CERTIFIRE certificate for the glazing system, whichever is the lesser.
- Other CERTIFIRE approved glazing seals may be acceptable subject to the limitations within the relevant certificate. This Certificate of Approval relates to the sizes of PYRANOVA® glass shown in Figures 1 and 2, when used in conjunction with the above system. The aspect ratio of the glass may be unlimited within these aperture dimensions.



CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® 15-S2.0/2.1 Glass in timber door leaves for periods of 30 minutes integrity and 30 or 15 minutes insulation

This Certificate of Approval relates to the sizes of PYRANOVA® 15-S2.0/2.1 glass shown in Figures 1 and 2 below, when used in conjunction with the system detailed within the preceding figures:

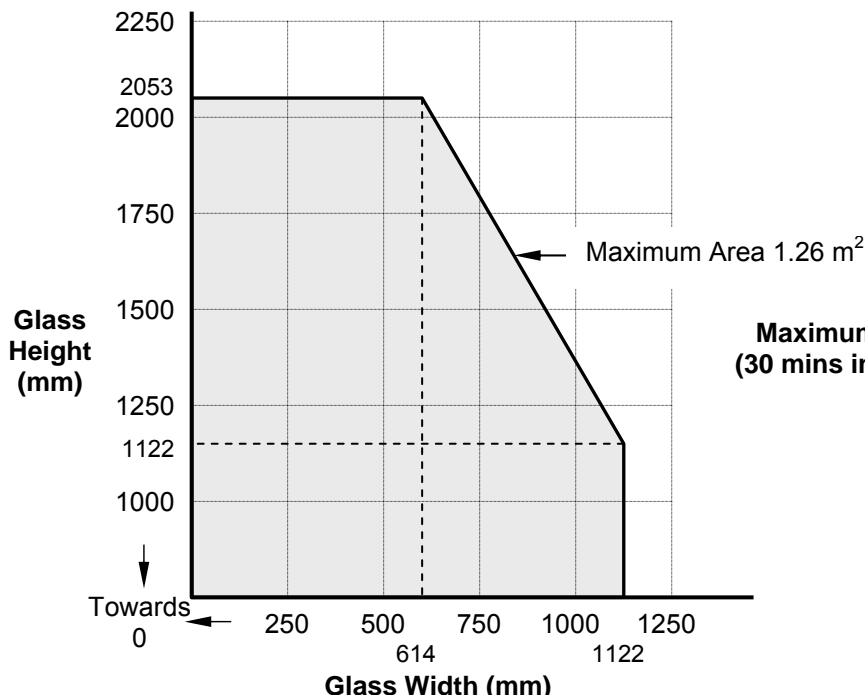


Figure 1.
Maximum Permitted Pane Dimensions
(30 mins integrity and 15 mins insulation)


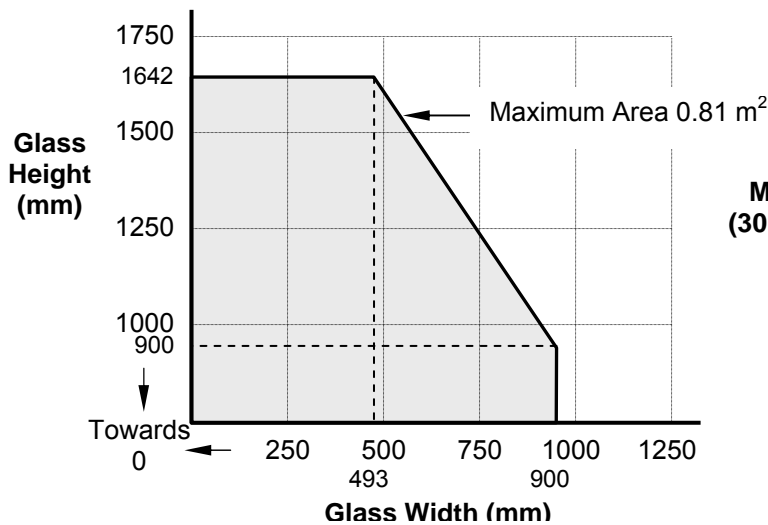


Figure 2.
Maximum Permitted Pane Dimensions
(30 mins integrity and 30 mins insulation)

CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® 15-S2.0/2.1 Glass in timber framed fixed lights for periods of 30 minutes integrity and 30 or 15 minutes insulation

The glass shall be glazed utilising the following basic specification:

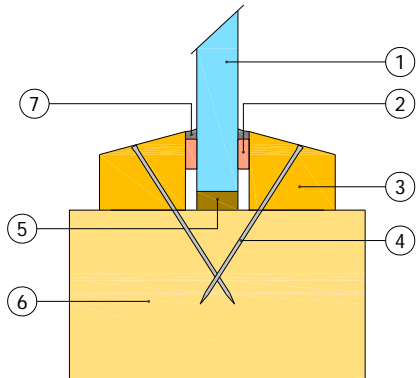

- 1 PYRANOVA® 15-S2.0/2.1 glass
- 2 12 mm by 3 mm Hodgson Sealants Firestrip 30
- 3 21 mm high by 23 mm wide square or up to 15° chamfered hardwood glazing beads, minimum density 640 kg/m³
- 4 51 mm long steel oval nails or screws at 150 mm centres (45° to glass)
- 5 Non-combustible setting blocks
- 6 79 mm by 45 mm (minimum) softwood framing sections, minimum density 450 kg/m³
- 7 Neutral silicone capping

This Certificate of Approval relates to the sizes of PYRANOVA® 15-S2.0/2.1 glass shown in Figure 3 below, when used in conjunction with the above system. The aspect ratio of the glass may be unlimited within these aperture dimensions. **This system shall only be used for single fixed lights, i.e transoms and mullions are not permitted.**

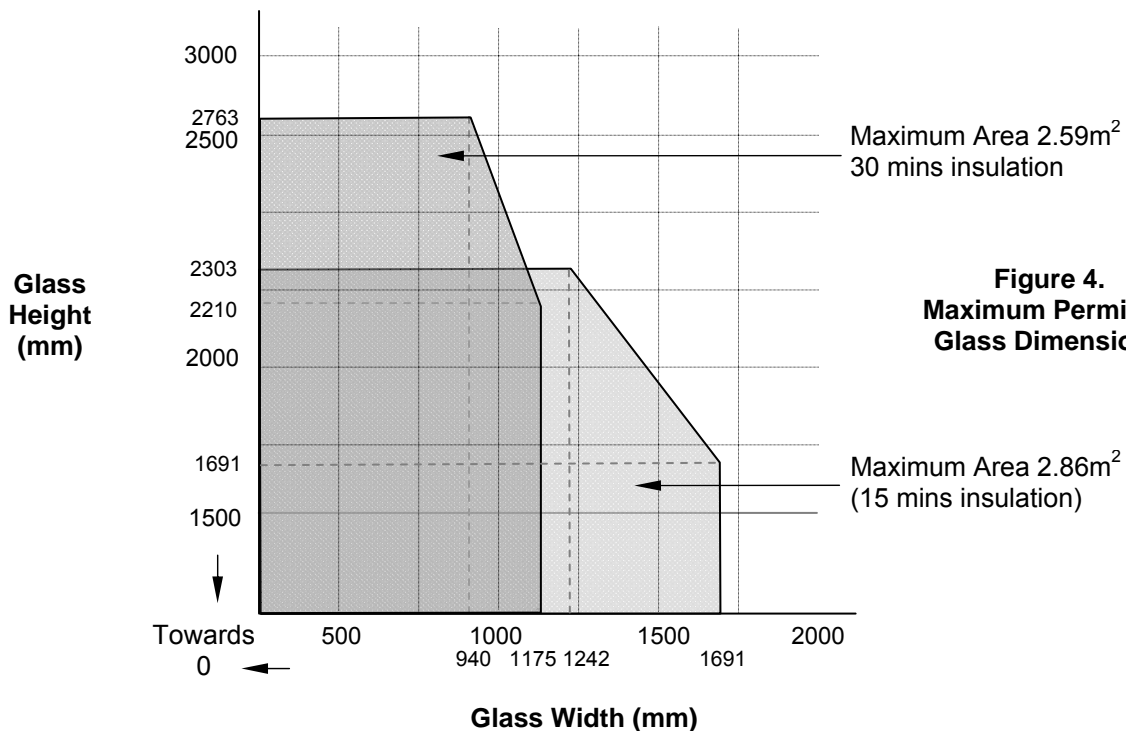


Figure 4.
Maximum Permitted
Glass Dimensions




CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® 15-S2.0/2.1 Glass in steel framed screens for periods of 30 minutes integrity and insulation

The glass shall be glazed within a previously fire tested or CERTIFIRE approved insulated steel framing system utilising the following basic specification:

- PYRANOVA® 15-S2.0/2.1 glass
- 15 mm by 6 mm ceramic fibre based glazing tape

The insulated steel framing system shall have test evidence or be CERTIFIRE approved for the inclusion of apertures of the proposed dimensions. An example of a typical framing system is shown below.

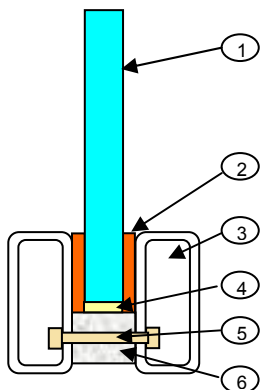

1	PYRANOVA® 15-S2.0/2.1
2	Fiberfrax Glazing Tape 3 x 12mm
3	Mild Steel Profile 50 x 20 x 2mm
4	Non-combustible setting blocks
5	M6 Steel screws
6	Priodek 30 x 22mm Insulation board

This Certificate of Approval relates to the sizes of PYRANOVA® 30-S2.0/2.1 glass shown in Figure 4 below, when used in conjunction with the above system. The aspect ratio of the glass may be unlimited within these aperture dimensions. **The range of PYRANOVA® glasses is currently available up to a maximum size of 2900 mm by 1900 mm.**

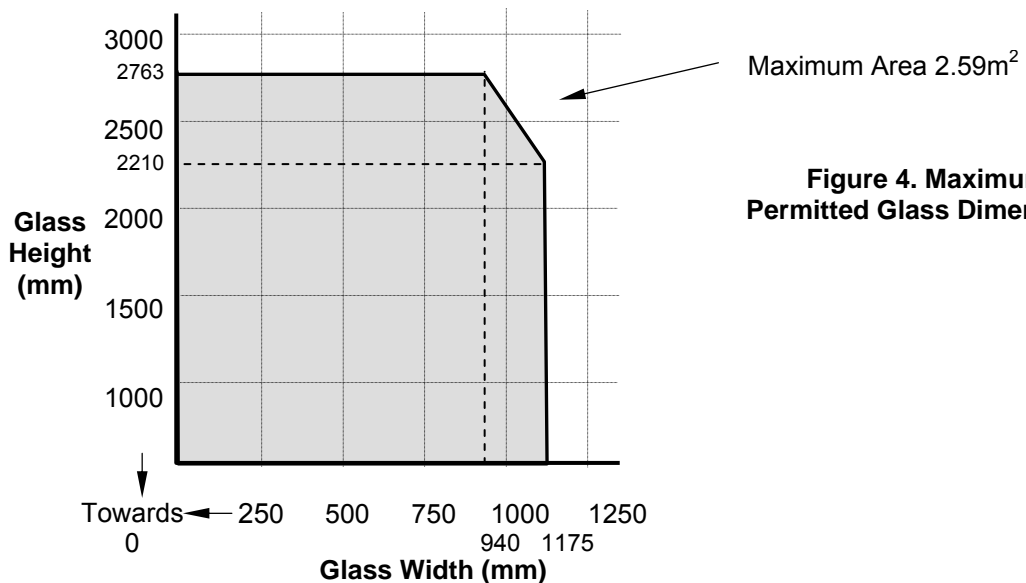



Figure 4. Maximum Permitted Glass Dimensions



CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® 30-S2.0/2.1 Glass in timber door leaves for periods of 30 minutes integrity and insulation

The glass shall be glazed within a previously fire tested or CERTIFIRE approved timber based doorset utilising the following basic specification:

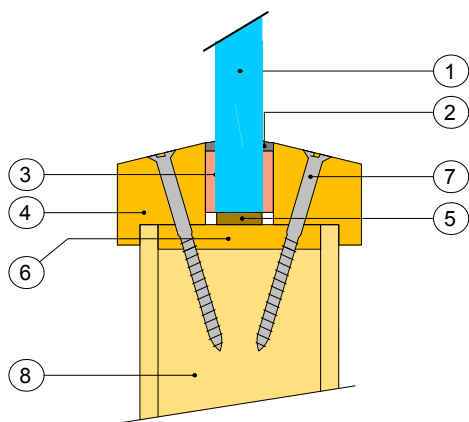

- 1 PYRANOVA® 30-S2.0/2.1 glass
- 2 Neutral silicone capping
- 3 9 x 3mm close cell tape
- 4 Softwood glazing beads 18 mm wide by 21.5 mm high (minimum)
- 5 Promatect H Non-combustible setting blocks
- 6 6 mm thick hardwood aperture liner
- 7 60 mm x 4mm screws at ≤ 400 mm centres
- 8 Nominally 44 mm thick FD30 door leaf

This Certificate of Approval relates to the sizes of PYRANOVA® 30-S2.0/2.1 glass shown in Figure 5 below, when used in conjunction with the above system. The aspect ratio of the glass may be unlimited within these aperture dimensions. **The range of PYRANOVA® glasses is currently available up to a maximum size of 2900 mm by 1900 mm.**


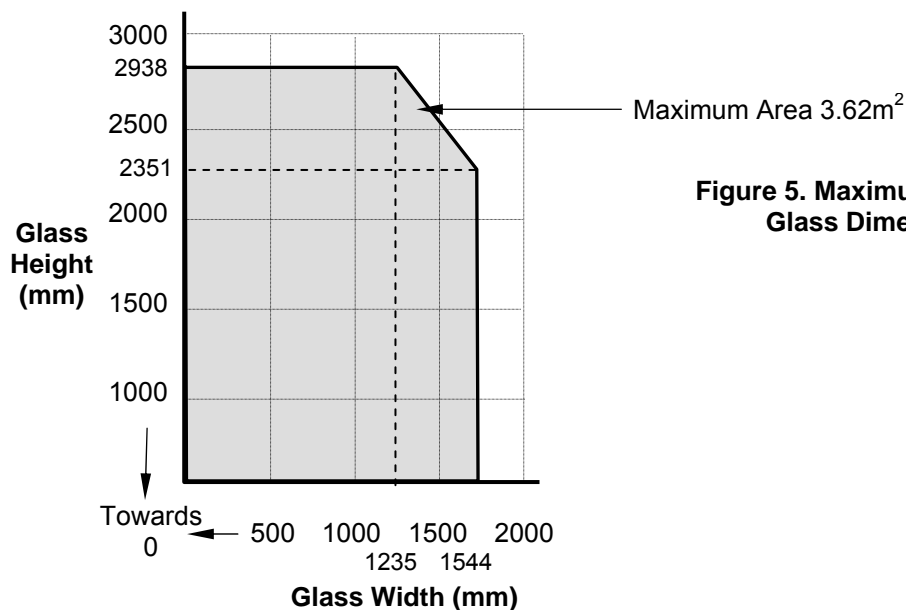


Figure 5. Maximum Permitted Glass Dimensions

CERTIFICATE No CF 386
SCHOTT UK LIMITED


PYRANOVA® 30-S2.0/2.1 Glass in timber framed screens for periods of 30 minutes integrity and insulation

The glass shall be glazed utilising the following basic specification:

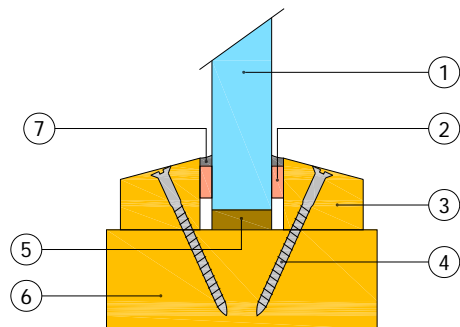

- 1 PYRANOVA® 30-S2.0/2.1 glass
- 2 8 mm wide by 3 mm thick closed cell foam tape
- 3 18 mm high by 20 mm wide square or up to 10° chamfered softwood glazing beads, minimum density 450 kg/m³
- 4 40 mm long steel screws at 400 mm centres (30° to glass) or 51 mm long steel oval nails at 150 mm centres
- 5 Non-combustible setting blocks
- 6 68 mm by 20 mm (minimum) softwood framing sections, minimum density 450 kg/m³
- 7 Neutral silicone capping

This Certificate of Approval relates to the sizes of PYRANOVA® 30-S2.0/2.1 glass shown in Figure 6 below, when used in conjunction with the above system. The aspect ratio of the glass may be unlimited within these aperture dimensions. **The range of PYRANOVA® glasses is currently available up to a maximum size of 2900 mm by 1900 mm.**

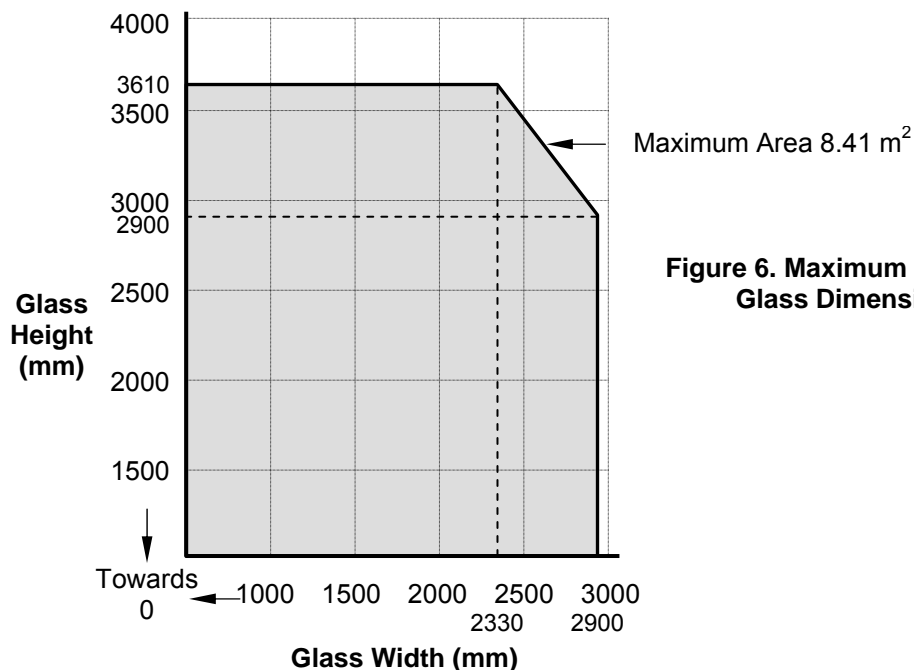


CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® 30-S2.0/2.1 Glass in steel door leaves for periods of 30 minutes integrity and insulation

The glass shall be glazed within a previously fire tested (see example below) or a CERTIFIRE approved steel profiled door leaf framing system.

Note: glass used in this application may be laminated, acid etched, tinted, patterned or screen printed subject to the conditions specified on Page 3 of this document.

A typical door section is shown below.

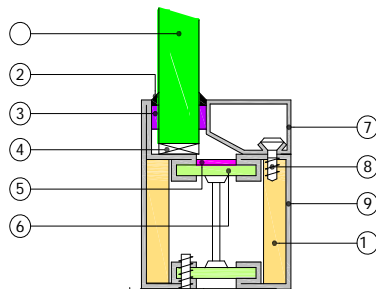


1. PYRANOVA® 30-S2.0/2.1 glass
2. Neutral silicone capping
3. Ceramic fibre based glazing tape, 20 mm x 5 mm
4. Setting block
5. Fire resistant laminate, 14 mm x 1.5 mm
6. Fibre reinforced strip, 31 mm x 5 mm
7. Glazing bead, 30 mm x 20 mm x 1.3 mm
8. Screw, 15 mm long
9. Steel section, 73 mm x 59 mm x 50 mm x 1.6 mm
10. Fire resistant ceramic filling

The steel profiled door framing system shall have test evidence (such as JANSEN JANISOL 2 or ECONOMY 50) or be CERTIFIRE approved for the inclusion of apertures of the proposed dimensions. If the proposed doorset is to be used in double-leaf configuration, the test or assessment evidence should be applicable to double-leaf configurations. Likewise, if the proposed doorset is to be used in the unlatched configuration, the available evidence should be applicable to unlatched doorsets. When used to glaze CERTIFIRE approved doorsets which have smaller apertures than allowed in this certificate, the aperture sizes specified in the doorset certificate shall take precedence.

This Certificate of Approval relates to the sizes of PYRANOVA® 30 – S2.0/2.1 glass shown in Figure 7 below, when used in conjunction with the above system. The aspect ratio of the glass may be unlimited within these aperture dimensions. **The range of PYRANOVA® glasses is currently available up to a maximum size of 2900 mm by 1900 mm.**

CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® 30-S2.0/2.1 Insulating Glass Units in steel door leaves for periods of 30 minutes integrity and insulation (continued)

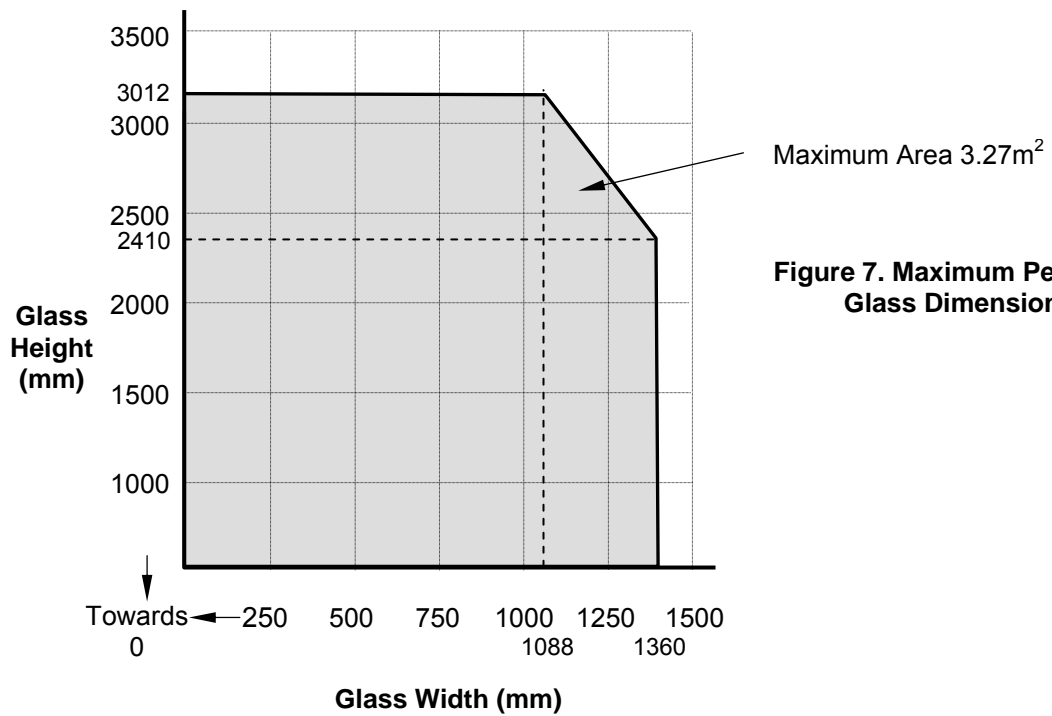


CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® 30-S2.0/2.1 Glass in steel framed screens for periods of 30 minutes integrity and insulation

The glass shall be glazed within a previously fire tested or CERTIFIRE approved insulated steel framing system utilising the following basic specification:

- PYRANOVA® 30-S2.0/2.1 glass
- 15 mm by 6 mm ceramic fibre based glazing tape

The insulated steel framing system shall have test evidence or be CERTIFIRE approved for the inclusion of apertures of the proposed dimensions. Examples of framing systems are shown below.

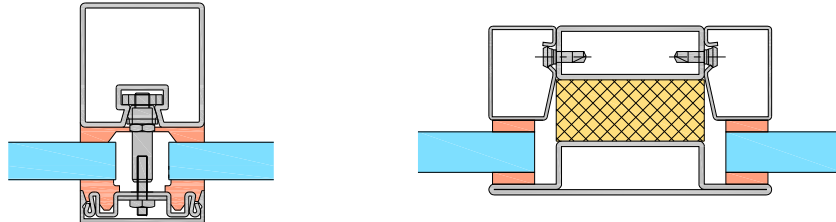

This Certificate of Approval relates to the sizes of PYRANOVA® 30-S2.0/2.1 glass shown in Figure 8 below, when used in conjunction with the above system. The aspect ratio of the glass may be unlimited within these aperture dimensions. **The range of PYRANOVA® glasses is currently available up to a maximum size of 2900 mm by 1900 mm.**

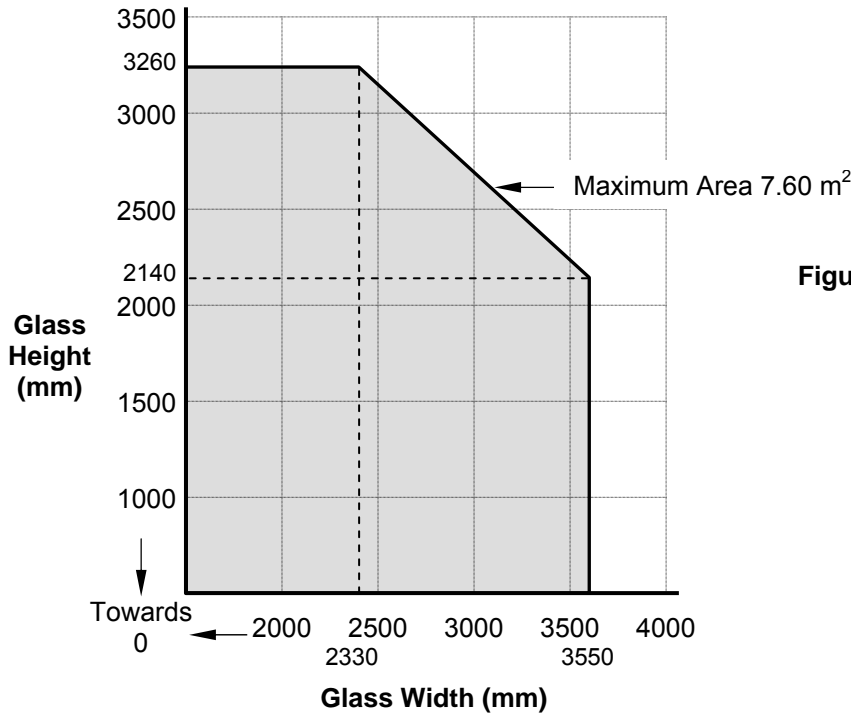


Figure 8. Maximum Permitted Glass Dimensions




CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® 30-S2.0/2.1 Insulating Glass Units in timber framed screens for periods of 30 minutes integrity and insulation



The glass shall be glazed within a previously fire tested or CERTIFIRE approved timber framing system utilising the following basic specification:

- An integral blind can be contained in the airspace
- Insulating Glass units may be installed with PYRANOVA® to either face.

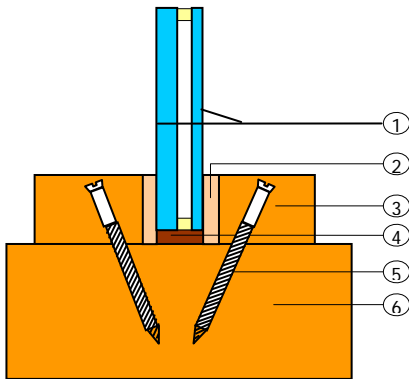

- 1 PYRANOVA® 30-S2.0/2.1 glass – aluminium spacer – minimum 4 mm thick glass of any type including toughened, laminated, annealed or Low E glass
- 2 20 mm wide by 4 mm thick ceramic fibre based glazing tape
- 3 20 mm high by 30 mm wide square hardwood glazing beads, minimum density 600 kg/m³
- 4 Non-combustible setting blocks
- 5 70 mm long steel screws at 200 mm centres (30° to glass)
- 6 100 mm by 40 mm (minimum) hardwood framing sections, minimum density 600 kg/m³

This Certificate of Approval relates to the sizes of PYRANOVA® 30-S2.0/2.1 glass shown in Figure 9 below, when used in conjunction with the above system. The aspect ratio of the glass may be unlimited within these aperture dimensions. **The range of PYRANOVA® glasses is currently available up to a maximum size of 2900 mm by 1900 mm.**

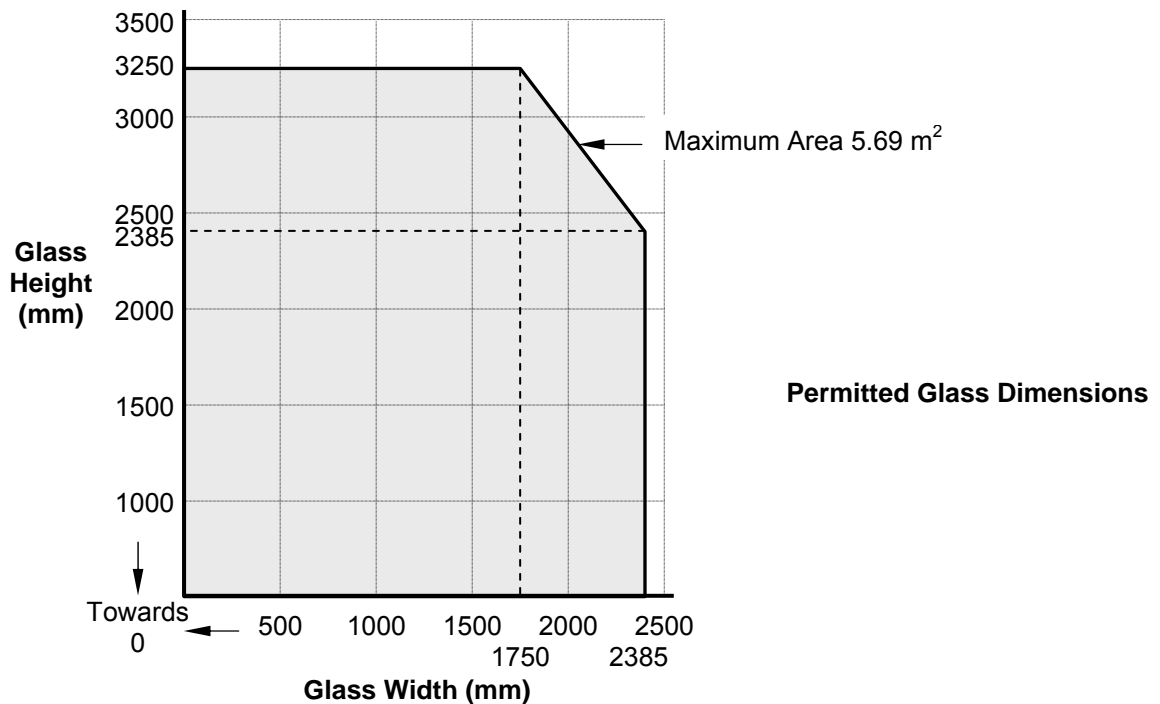


CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® 30-S2.0/2.1 Insulating Glass Units in steel door leaves for periods of 30 minutes integrity and insulation

The glass shall be glazed within a previously fire tested (see example below) or a CERTIFIRE approved steel profiled door leaf framing system.

Note: glass used in this application may be laminated, acid etched, tinted, patterned or screen printed subject to the conditions specified on Page 3 of this document.

A typical door section is shown below.

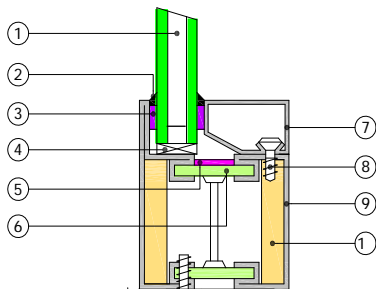

1. PYRANOVA® 30-S2.0/2.1 glass in IGU
2. Neutral silicone capping
3. Ceramic fibre based glazing tape, 20 mm x 5 mm
4. Setting block
5. Fire resistant laminate, 14 mm x 1.5 mm
6. Fibre reinforced strip, 31 mm x 5 mm
7. Glazing bead, 30 mm x 20 mm x 1.3 mm
8. Screw, 15 mm long
9. Steel section, 73 mm x 59 mm x 50 mm x 1.6 mm
10. Fire resistant ceramic filling


The steel profiled door framing system shall have test evidence (such as JANSEN JANISOL 2 or ECONOMY 50) or be CERTIFIRE approved for the inclusion of apertures of the proposed dimensions. If the proposed doorset is to be used in double-leaf configuration, the test or assessment evidence should be applicable to double-leaf configurations. Likewise, if the proposed doorset is to be used in the unlatched configuration, the available evidence should be applicable to unlatched doorsets. When used to glaze CERTIFIRE approved doorsets which have smaller apertures than allowed in this certificate, the aperture sizes specified in the doorset certificate shall take precedence.

This Certificate of Approval relates to the sizes of PYRANOVA® 30 – S2.0/2.1 glass shown in Figure 10 below, when used in conjunction with the above system. The aspect ratio of the glass may be unlimited within these aperture dimensions. **The range of PYRANOVA® glasses is currently available up to a maximum size of 2900 mm by 1900 mm.**



CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® 30-S2.0/2.1 Insulating Glass Units in steel door leaves for periods of 30 minutes integrity and insulation (continued)

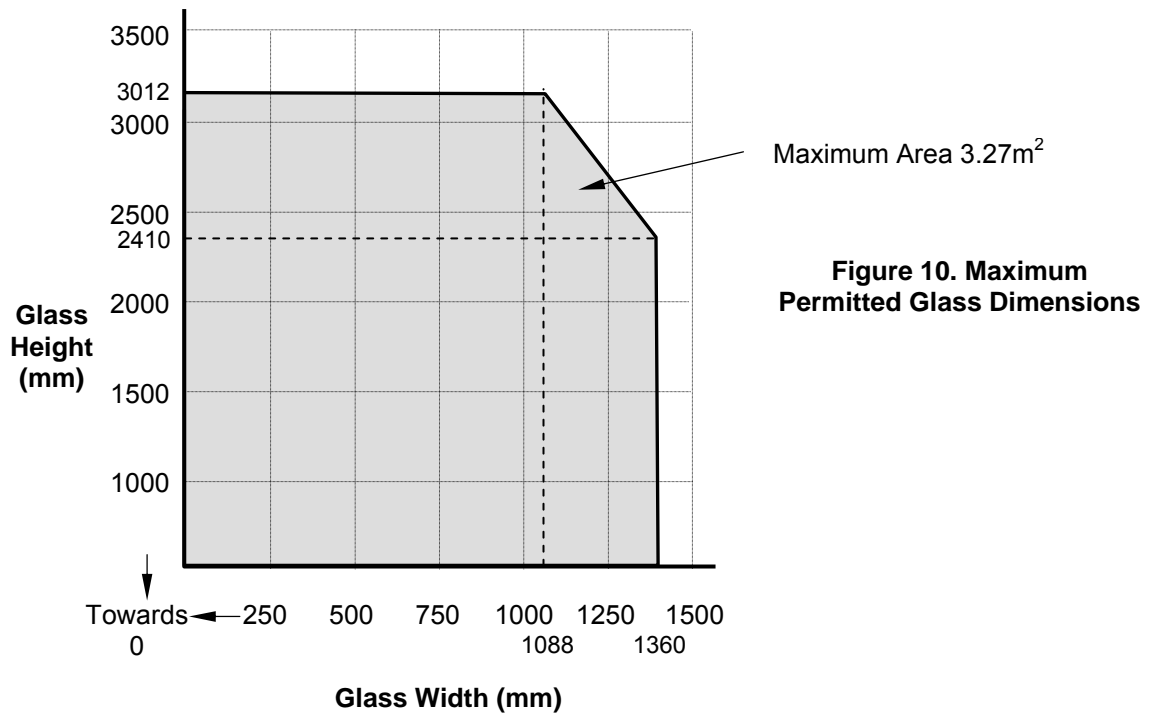




CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® 30-S2.0/2.1 Glass within Insulated Glass Units in metallic (steel or aluminium) framed screens for periods of 30 minutes integrity and insulation

The glass shall be glazed within a previously fire tested or CERTIFIRE approved insulated metallic (steel or aluminium) framing system utilising the following basic specification:

- PYRANOVA® 30-S2.0/2.1 glass – aluminium spacer – minimum 4 mm thick glass of any type including toughened, laminated, annealed or Low E glass
- 15 mm by 6 mm ceramic fibre based glazing tape
- Insulating Glass units may be installed with PYRANOVA® to either face.
- Venetian Blinds may be included within the units.

The insulated metallic (steel or aluminium) framing system shall have test evidence or be CERTIFIRE approved for the inclusion of apertures of the proposed dimensions. Examples of framing systems are shown below:

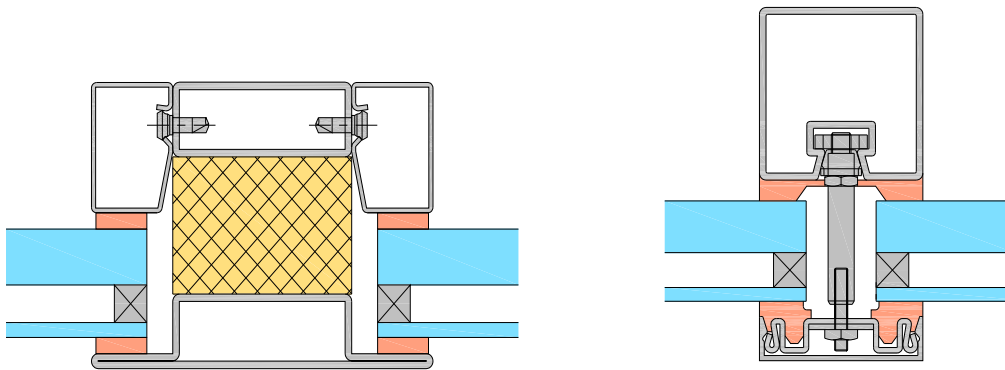


A handwritten signature in black ink, appearing to be "K. J. ...".



CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® 30-S2.0/2.1 Glass within Insulated Glass Units in metallic (steel or aluminium) framed screens for periods of 30 minutes integrity and insulation (continued)

This Certificate of Approval relates to the sizes of PYRANOVA® 30-S2.0/2.1 glass shown in Figure 11 below, when used in conjunction with the above system. The aspect ratio of the glass may be unlimited within these aperture dimensions. **The range of PYRANOVA® glasses is currently available up to a maximum size of 2900 mm by 1900 mm.**

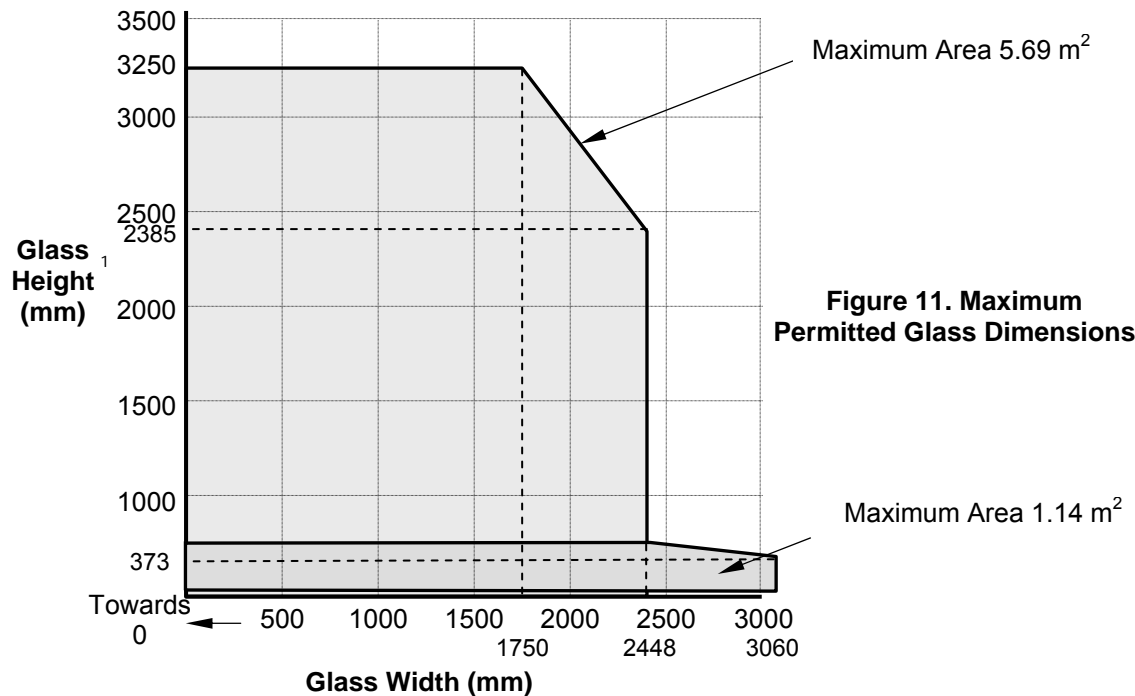


CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® 30-S2.0/2.1 Insulating Glass Units in timber framed screens for periods of 60 minutes integrity and 30 minutes insulation

The glass shall be glazed within a previously fire tested or CERTIFIRE approved timber framing system utilising the following basic specification:

- An integral blind can be contained in the airspace
- Insulating Glass units may be installed with PYRANOVA® to either face.

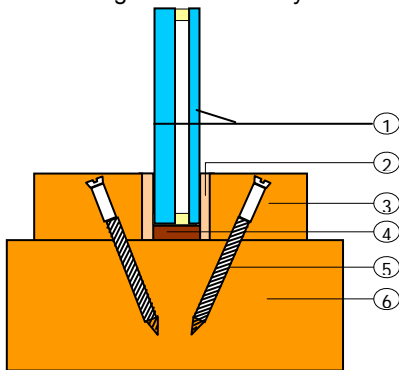

- 1 PYRANOVA® 30-S2.0/2.1 glass – aluminium spacer – minimum 4 mm thick glass of any type including toughened, laminated, annealed or Low E glass
- 2 20 mm wide by 4 mm thick ceramic fibre based glazing tape
- 3 20 mm high by 30 mm wide square hardwood glazing beads, minimum density 600 kg/m³
- 4 Non-combustible setting blocks
- 5 70 mm long steel screws at 200 mm centres (30° to glass)
- 6 100 mm by 40 mm (minimum) hardwood framing sections, minimum density 600 kg/m³

This Certificate of Approval relates to the sizes of PYRANOVA 30-S2.0/2.1 glass shown in Figure 12 below, when used in conjunction with the above system. The aspect ratio of the glass may be unlimited within these aperture dimensions. **The range of PYRANOVA® glasses is currently available up to a maximum size of 2900 mm by 1900 mm.**

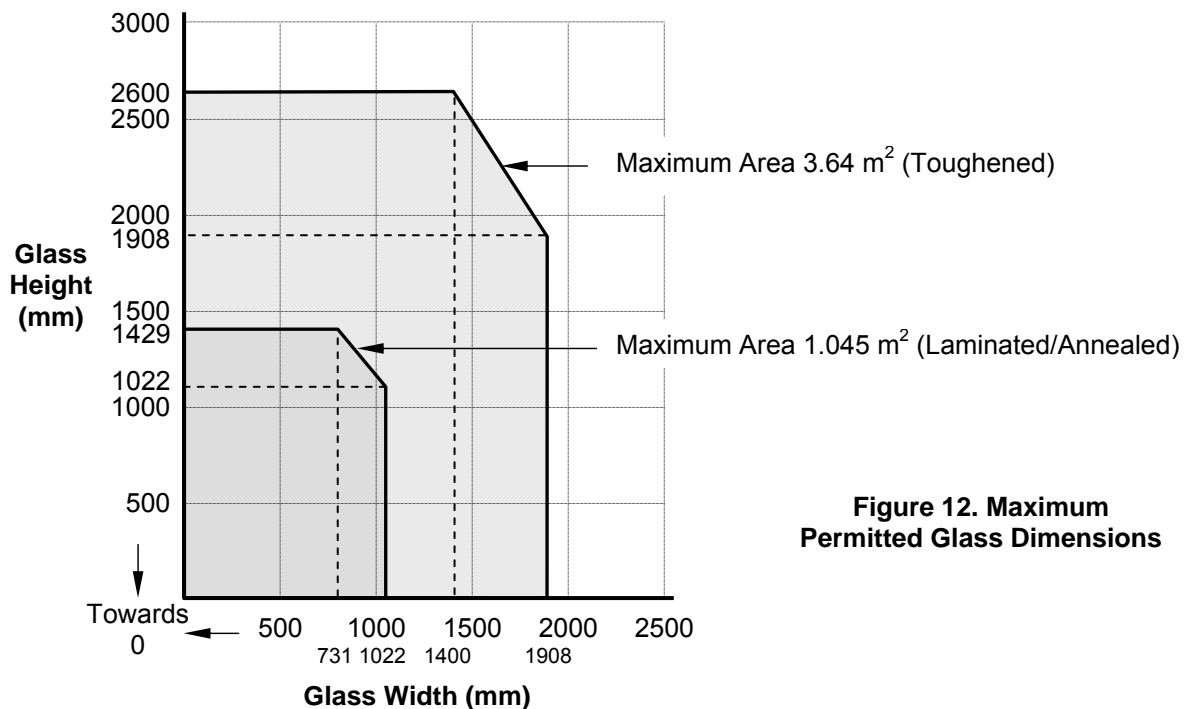


Figure 12. Maximum Permitted Glass Dimensions

CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® 30-S2.0/2.1 Glass within Insulating Glass Units in metallic (steel or aluminium) framed Screens for periods of 60 minutes integrity and 30 minutes insulation

The glass shall be glazed within a previously fire tested or CERTIFIRE approved insulated metallic (steel or aluminium) framing system utilising the following basic specification:

- PYRANOVA® 30-S2.0/2.1 glass – aluminium spacer – minimum 4 mm thick glass of any type including toughened, laminated, annealed or Low E glass
- 15 mm by 6 mm ceramic fibre based glazing tape
- Insulating Glass Units glazed units may be installed with PYRANOVA® to either face.

The insulated metallic (steel or aluminium) framing system shall have test evidence or be CERTIFIRE approved for the inclusion of apertures of the proposed dimensions. Examples of framing systems are shown below:



This Certificate of Approval relates to the sizes of PYRANOVA® 30-S2.0/2.1 glass shown in Figure 13 below, when used in conjunction with the above system. The aspect ratio of the glass may be unlimited within these aperture dimensions.

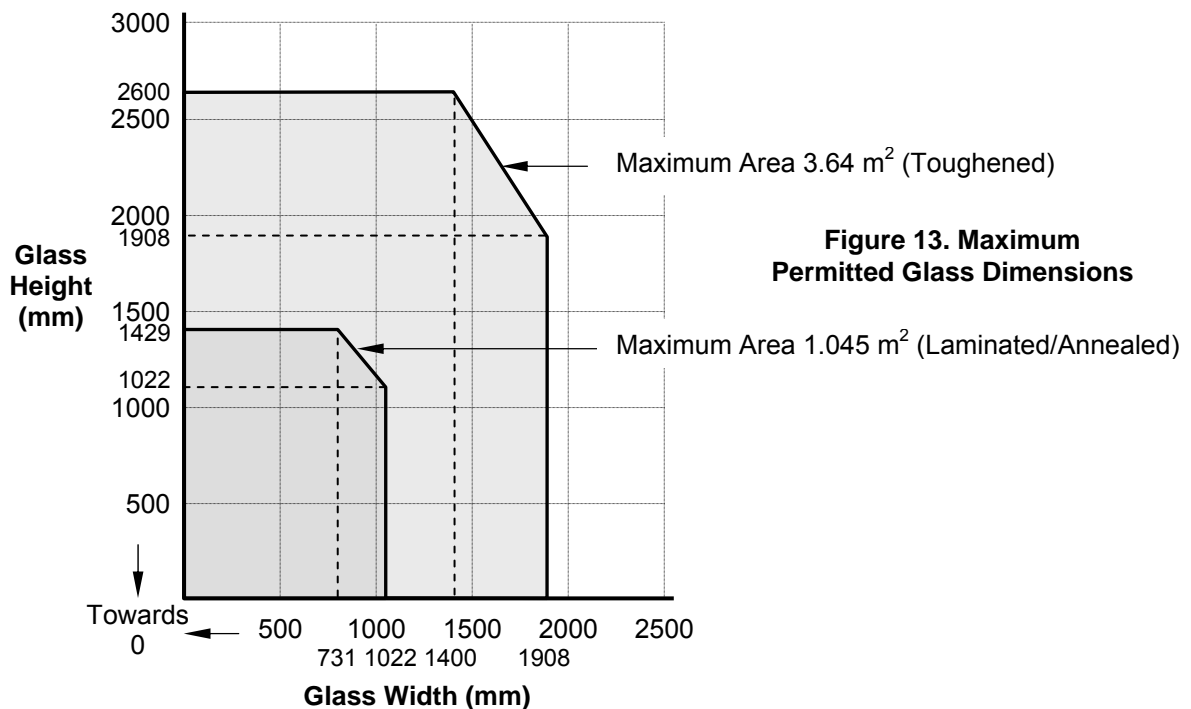



Figure 13. Maximum Permitted Glass Dimensions



CERTIFICATE No CF 386
SCHOTT UK LIMITED


Butt-Jointed PYRANOVA® 30-S2.0/2.1 Glass in timber framed screens for periods of 30 minutes integrity and insulation

The glass shall be glazed utilising the following basic specification:


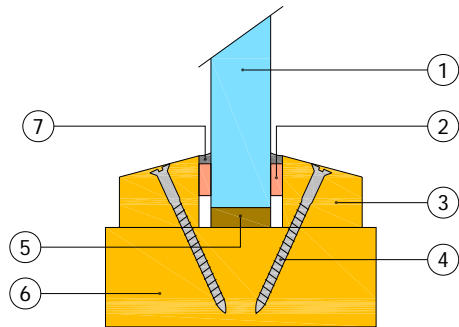


- 1 PYRANOVA® 30-S2.0/2.1 glass
- 2 8 mm wide by 3 mm thick closed cell foam tape
- 3 28 mm high by 20 mm wide square or up to 10° chamfered hardwood glazing beads, minimum density 550 kg/m³
- 4 60 mm long steel screws at 300 mm centres (30° to glass)
- 5 Non-combustible setting blocks
- 6 70 mm by 40 mm (minimum) hardwood framing sections, minimum density 550 kg/m³
- 7 Neutral silicone capping

The system may include vertically orientated butt joints in a range of angles. In order to ensure the correct specification is utilised for such specialist glazing, further information should be sought from the manufacturer.



Nominal 5mm wide joint

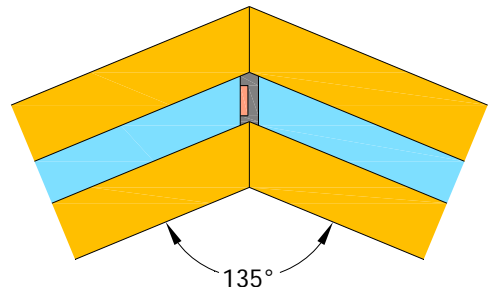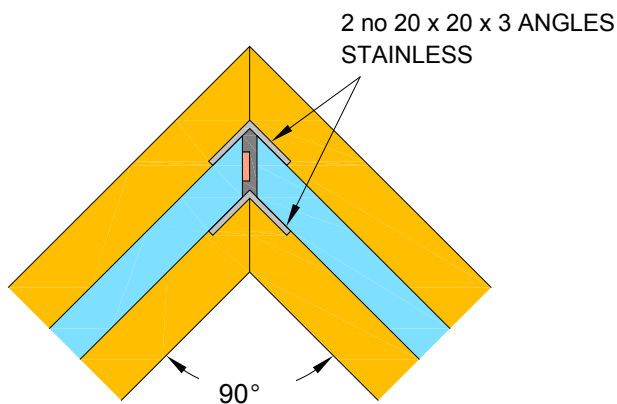

CERTIFICATE No CF 386
SCHOTT UK LIMITED

Butt-Jointed PYRANOVA® 30-S2.0/2.1 Glass in timber framed screens for periods of 30 minutes integrity and insulation (continued)

This Certificate of Approval relates to the sizes of PYRANOVA® 30-S2.0/2.1 glass shown in Figure 14 below, when used in conjunction with the above system. The aspect ratio of the glass may be unlimited within these aperture dimensions. The maximum permitted pane dimensions depend on the butt-joint specification and also requires the fire risk side to be identified for angled butt-joints.

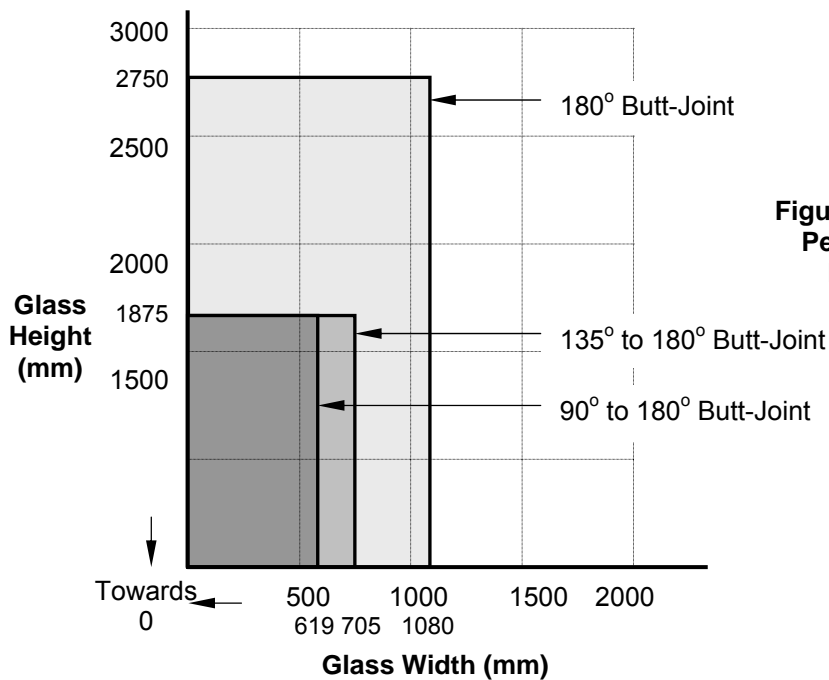
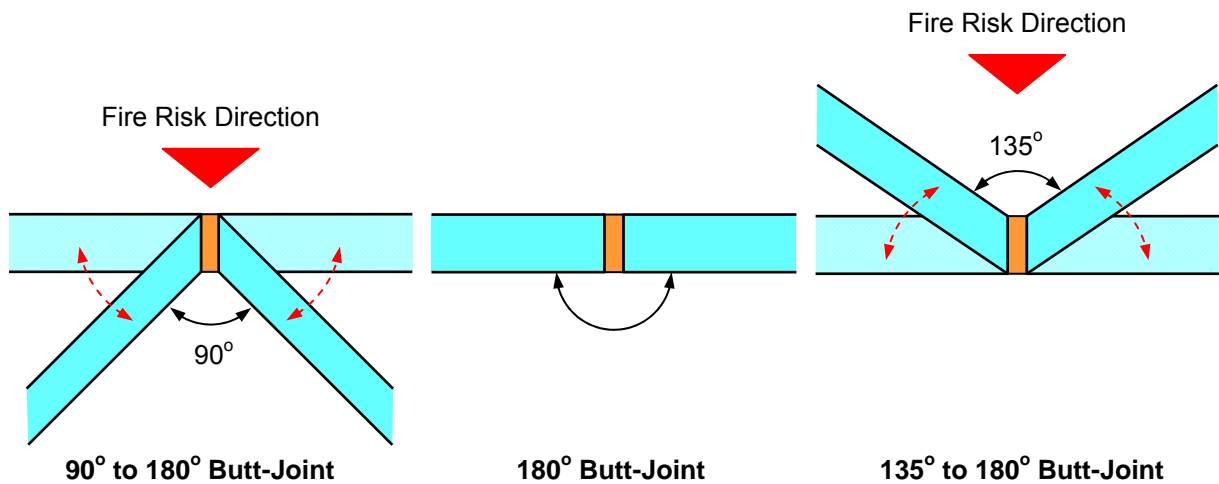



Figure 14. Maximum Permitted Glass Dimensions

CERTIFICATE No CF 386
SCHOTT UK LIMITED


Butt-Jointed PYRANOVA® 30- S2.0/2.1 Glass in Steel framed screens for periods of 30 minutes integrity and insulation

The system may include vertically orientated butt joints in a range of angles. In order to ensure the correct specification is utilised for such specialist glazing, further information should be sought from the manufacturer.



The glass shall be glazed utilising the following basic specification:

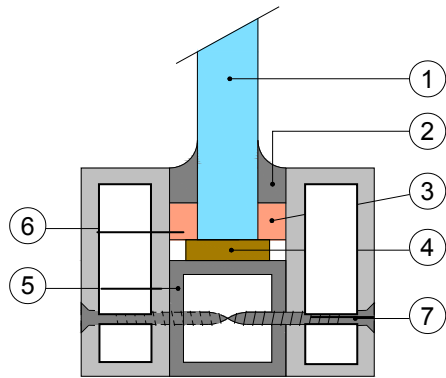

- 1 PYRANOVA® 30-S2.0/2.1 glass
- 2 Neutral silicone capping
- 3 15 mm wide by 3-6 mm thick ceramic fibre based glazing tape
- 4 Non-combustible setting blocks
- 5 Steel Section 30 mm by 30 mm by 3 mm
- 6 55 mm by 19 mm hollow steel box section
- 7 35 mm long steel screws at 250 mm centres



Nominal 5mm wide joint

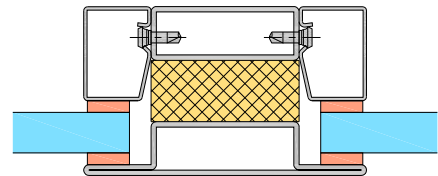

In order to ensure the correct specification is utilised for such specialist glazing, further information should be sought from the manufacturer.



CERTIFICATE No CF 386
SCHOTT UK LIMITED

Butt-Jointed PYRANOVA® 30- S2.0/2.1 Glass in Steel framed screens for periods of 30 minutes integrity and insulation (continued)

This Certificate of Approval relates to the sizes of PYRANOVA® 30-S2.1 glass shown in Figure 15 below, when used in conjunction with the above system. The aspect ratio of the glass may be unlimited within these aperture dimensions. **The range of PYRANOVA® glasses is currently available up to a maximum size of 2900 mm by 1900 mm.**


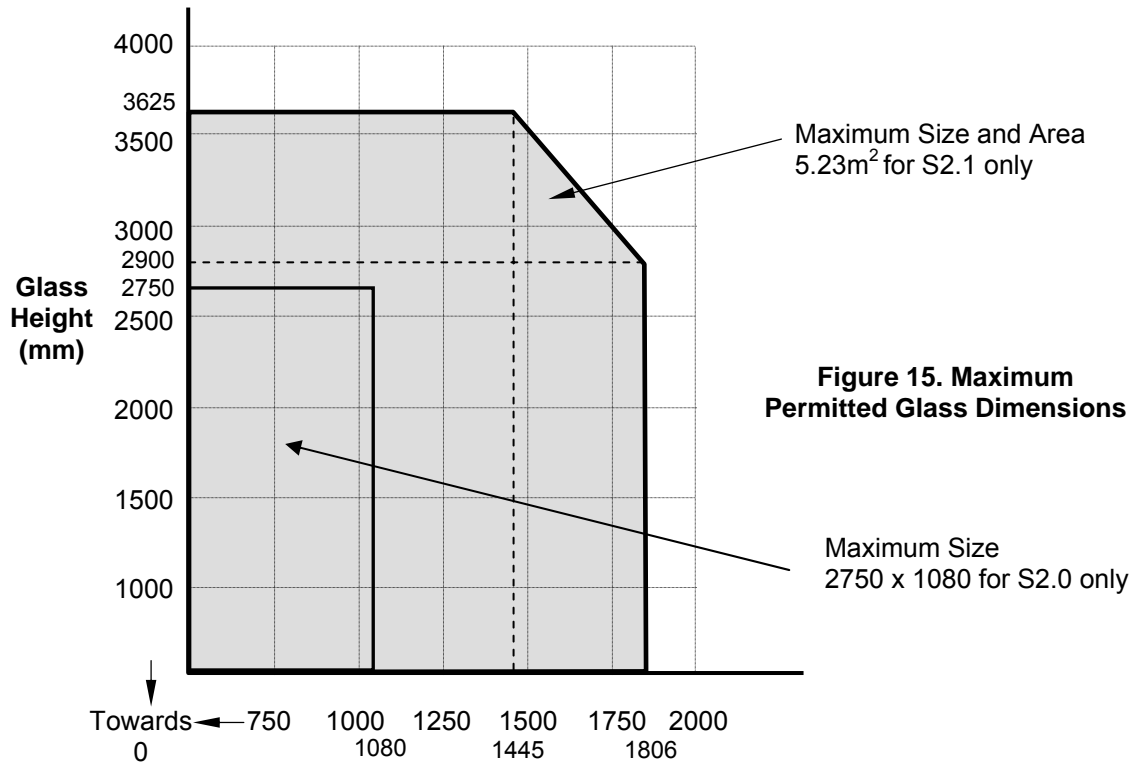


Figure 9. Maximum



CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® 60-S2.0/2.1 Glass in steel door leaves for periods of 60 minutes integrity and insulation

The glass shall be glazed utilising the following basic steel profiled doorleaf framing system specification:

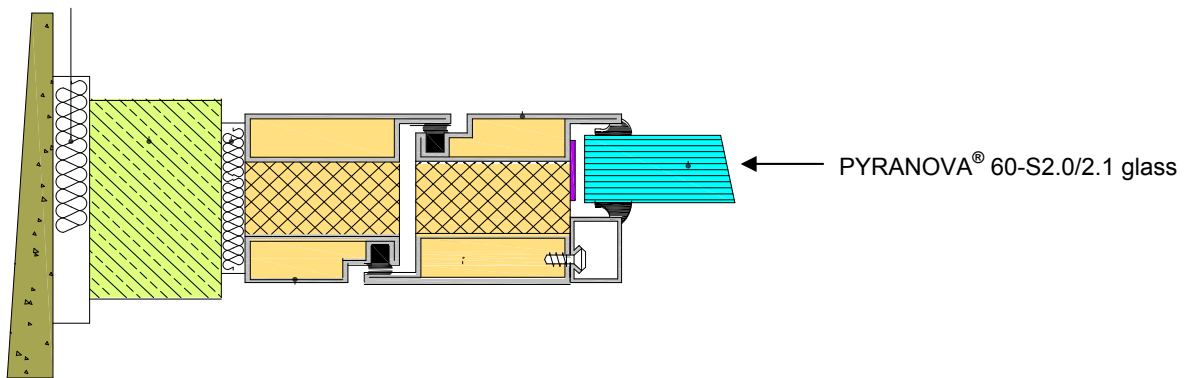

This Certificate of Approval relates to the sizes of PYRANOVA® 60-S2.0/2.1 glass shown in Figure 16 below, when used in conjunction with the above system. The aspect ratio of the glass may be unlimited within these aperture dimensions.

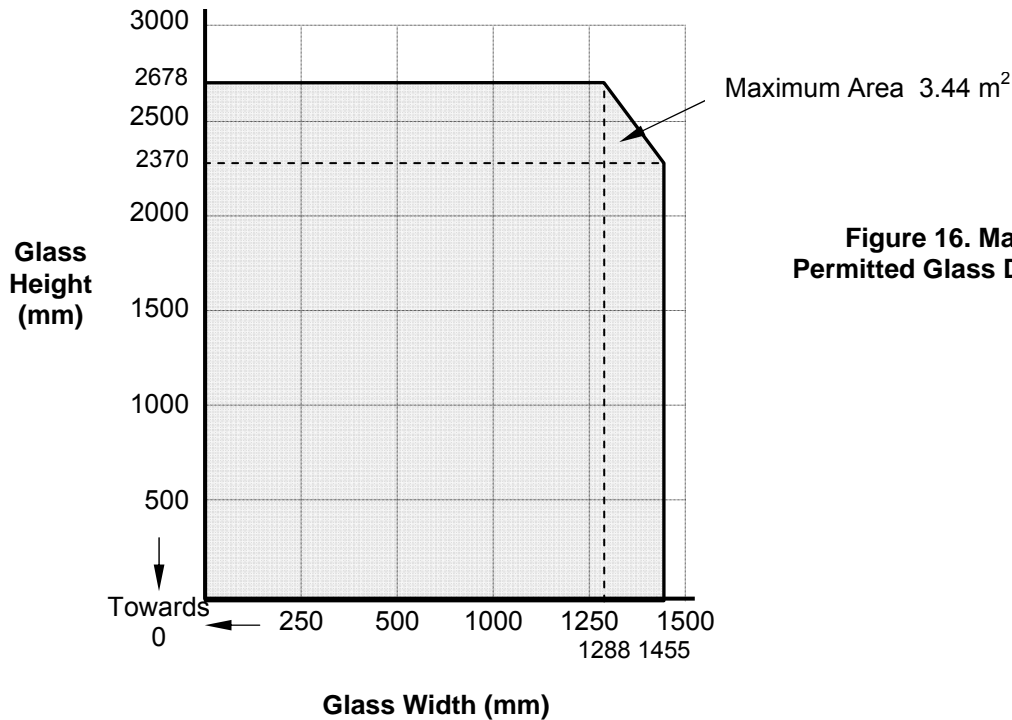
CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® 60-S2.0/2.1 Glass in steel framed screens for periods of 60 minutes integrity and insulation

The glass shall be glazed within a previously fire tested or CERTIFIRE approved insulated steel framing system utilising the following basic specification:

- PYRANOVA® 60-S2.0/2.1 glass
- 15 mm by 6 mm ceramic fibre based glazing tape

The insulated steel framing system shall have test evidence or be CERTIFIRE approved for the inclusion of apertures of the proposed dimensions. Examples of framing systems are shown below.

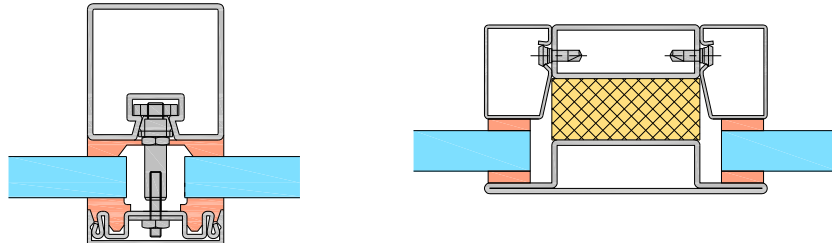

This Certificate of Approval relates to the sizes of PYRANOVA® 60-S2.0/2.1 glass shown in Figure 18 below, when used in conjunction with the above system. The aspect ratio of the glass may be unlimited within these aperture dimensions. **The range of PYRANOVA® glasses is currently available up to a maximum size of 2900 mm by 1900 mm.**


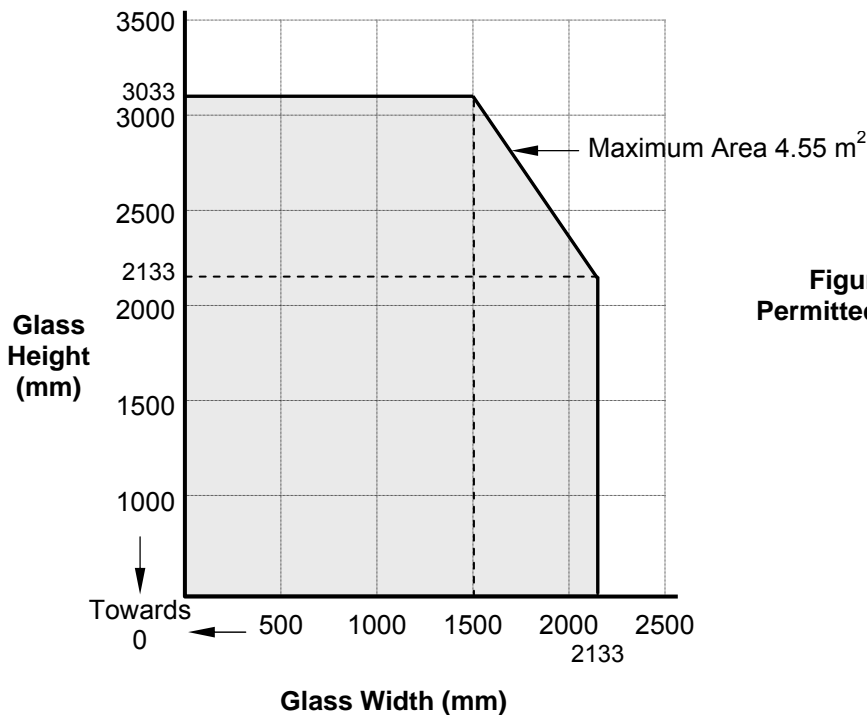


Figure 18. Maximum Permitted Glass Dimensions




CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® 60-S2.0/2.1 Insulating Glass Units in timber framed screens for periods of 60 minutes integrity and insulation

The glass shall be glazed within a previously fire tested or CERTIFIRE approved timber framing system utilising the following basic specification:

- An integral blind can be contained in the airspace
- Insulating Glass units may be installed with PYRANOVA® to either face.

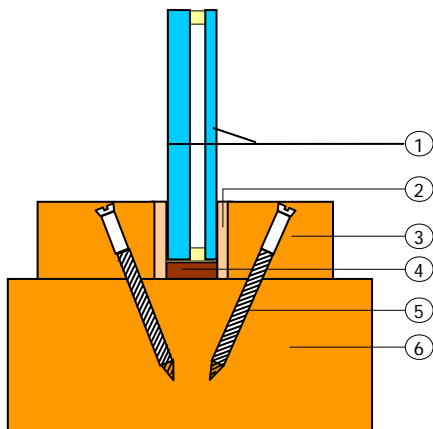

- 1 PYRANOVA® 60-S2.0/2.1 glass – aluminium spacer – minimum 4 mm thick glass of any type including toughened, laminated, annealed or Low E glass
- 2 20 mm wide by 4 mm thick ceramic fibre based glazing tape
- 3 20 mm high by 30 mm wide square hardwood glazing beads, minimum density 600 kg/m³
- 4 Non-combustible setting blocks
- 5 70 mm long steel screws at 200 mm centres (30° to glass)
- 6 100 mm by 40 mm (minimum) hardwood framing sections, minimum density 600 kg/m³

This Certificate of Approval relates to the sizes of PYRANOVA® 60-S2.0/2.1 glass shown in Figure 19 below, when used in conjunction with the above system. The aspect ratio of the glass may be unlimited within these aperture dimensions. **The range of PYRANOVA® glasses is currently available up to a maximum size of 2900 mm by 1900 mm.**

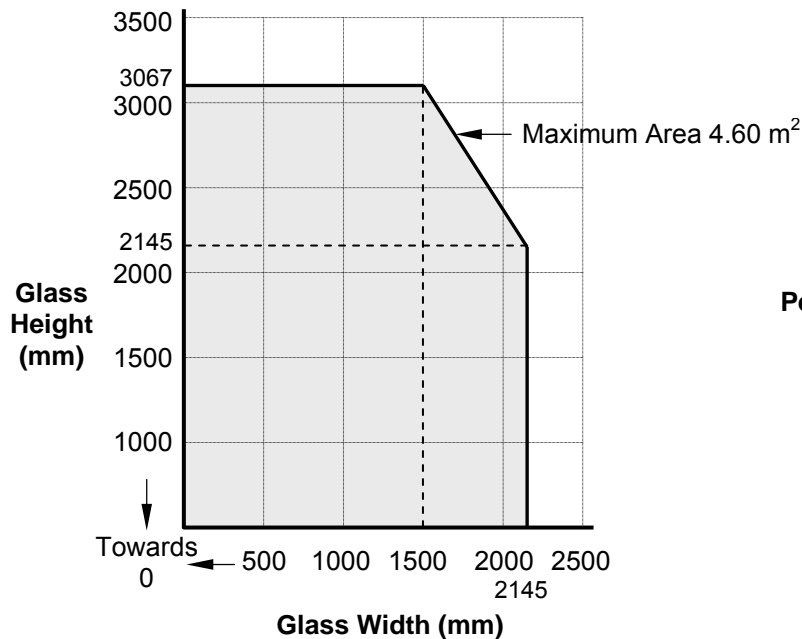


Figure 19. Maximum Permitted Glass Dimensions



CERTIFICATE No CF 386
SCHOTT UK LIMITED

PYRANOVA® 60-S2.0/2.1 Glass within Insulating Glass Units in steel framed screens for periods of 60 minutes integrity and insulation

The glass shall be glazed within a previously fire tested or CERTIFIRE approved insulated metallic (steel or aluminium) framing system utilising the following basic specification:

- PYRANOVA® 60-S2.0/2.1 glass – aluminium spacer – minimum 4 mm thick glass of any type including toughened, laminated, annealed or Low E glass
- An integral blind can be contained in the airspace
- 15 mm by 6 mm ceramic fibre based glazing tape
- Insulating Glass units may be installed with PYRANOVA® to either face.

The insulated metallic (steel or aluminium) framing system shall have test evidence or be CERTIFIRE approved for the inclusion of apertures of the proposed dimensions. Examples of framing systems are shown below:



This Certificate of Approval relates to the sizes of PYRANOVA® 60-S2.0/2.1 glass shown in Figure 20 below, when used in conjunction with the above system. The aspect ratio of the glass may be unlimited within these aperture dimensions. **The range of PYRANOVA® glasses is currently available up to a maximum size of 2900 mm by 1900 mm.**

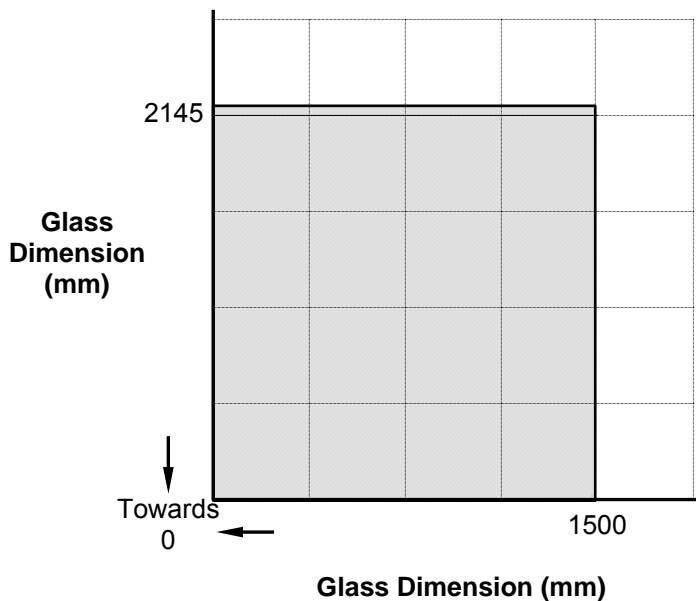


Figure 20. Maximum Permitted Glass Dimensions